

Features

IDNAC Repeaters provide enhanced power delivery to TrueAlert/TrueAlert ES addressable notification appliances controlled by IDNAC SLCs:

- Output voltage in alarm is maintained by an efficient switching regulator at 29 VDC during both AC input and battery backup conditions allowing strobes to operate at lower current
- With lower current strobes and regulated output voltage, wiring distance can be extended 2 to 3 times that of conventional notification, appliance loading can be increased, or smaller wire gauge can be used, all resulting in *installation savings* with high assurance that appliances that operate during normal system testing will operate during worst case alarm conditions

4009 IDNAC Repeaters receive an IDNAC SLC input and provide a repeated 3 A SLC output to extend SLC distance and power:

- Appliance control and address limit remains with the host IDNAC control panel. Repeater status is communicated to the control panel for system diagnostics and also locally indicated
- Repeater output extends supervisory capacity by up to 139 additional unit loads or 3 A
- Input SLC connection can be Class B or Class A
- Repeater output can be a Class A loop or a Class B output with internal connections for up to four (4) T-tapped output branches (Class A output requires A009-9814 Class A Adapter)
- Operation requires one IDNAC SLC address; Repeaters can be connected as one in series, or up to five (5) in parallel
- AC power input is 120 VAC or 220-240 VAC, 50/60 Hz, auto-select
- An on-board battery charger is provided with low AC battery disconnect selectable per Repeater (required for ULC listed applications)
- Operation is compatible with TrueAlert ES and TrueAlert addressable notification appliances and accessories
- Available with platinum or red cabinet
- Listed to UL 864 and ULC S527

Multiple wiring options are available:

- Wiring options include Class B multiple branch (up to 4) output, Class A loop extension, and Class A riser to Class B branches or a Class A loop output
- When the Repeater is part of a Class A loop from the IDNAC SLC source panel, up to twice the distance for the loop is available; (Class A loop repeating requires A009-9814 Class A Adapter)

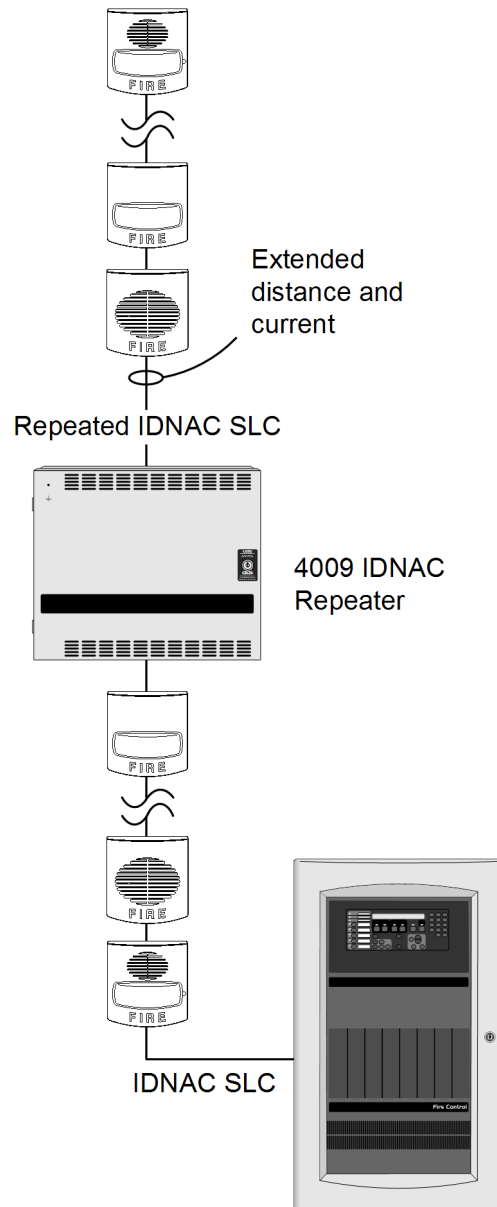


Figure 1: 4009 IDNAC Repeater Extends Distance and Current of IDNAC SLC

Class A Adapter A009-9814:

- Required when extending a Class A loop or to provide a Class A local loop SLC output
- Operation provides short circuit isolation between input and output terminals for improved IDNAC SLC survivability

Built-in battery charger

- Power supply charges up to 12.7 Ah batteries for in cabinet mounting and up to 25 Ah batteries with model A009-9801 external battery cabinet

Available auxiliary output:

- A 200 mA, 29 VDC constant auxiliary output is available; operation is maintained during battery backup

Introduction

Repeating IDNAC SLCs

Autocall fire alarm control panels with IDNAC SLC outputs provide individual address and control of TrueAlert and TrueAlert ES addressable notification appliances. When an IDNAC SLC reaches the current limit or the distance limit of the source IDNAC SLC, use of 4009 IDNAC Repeaters extends the IDNAC SLC with an additional 3 A of SLC current and up to 139 unit loads of additional supervisory capacity.

With IDNAC SLCs, a constant 29 VDC source voltage is maintained in alarm, even during battery standby, allowing strobes to operate at higher voltage with lower current and ensuring a consistent current draw and voltage drop margin under both primary power and secondary battery standby.

Efficiencies include wiring distances up to 2 to 3 times farther than with conventional notification, or support for more appliances per IDNAC SLC, or use of smaller gauge wiring, or combinations of these benefits, all providing installation and maintenance savings with high assurance that appliances that operate during normal system testing will operate during worst case alarm conditions.

Description

Three wiring configurations

Three wiring configurations are available to provide a variety of system solutions: Class B branch extension, Class A loop extension, and Class A riser to Class B branch extension or Class A loop output.

Class A Riser to Class B Branches or Class A Loops

For applications requiring a combination of wiring types, a Class A riser can drive up to five (5) 4009 IDNAC Repeaters with each Repeater capable of driving either single or multiple Class B branch output(s) or a Class A loop output. In this wiring application, the Repeater does not repeat in the Class A riser loop, it is connected as an appliance with Class A in/out wiring. To create a Class A loop output, the Repeater must be equipped with a A009-9814 Class A Adapter. (Refer to [Wiring Reference, Class A Riser Input with Class A Loop and Class B Branch Outputs](#) for additional details.)

Class B branch input wiring

Class B branch input wiring allows T-tapped connections to up to five (5) parallel connected 4009 IDNAC Repeaters. Each Repeater has on-board output terminal connections for up to four (4) output branch circuits, and additional branch circuits can be externally T-tapped as required. (Refer to [Wiring Reference, Class B Input with Class B Branch Circuit Outputs](#) for additional details.) Class A loop extensions use a single 4009 IDNAC Repeater to extend the current and distance of a single Class A loop allowing the loop distance to be doubled.

The Repeater communicates and repeats bi-directionally allowing Class A loop operation to be maintained in the event of an open circuit. This wiring connection requires use of the A009-9814 Class A adapter. (Refer to [Wiring Reference, Class A Loop Extension](#) for additional details.)

Product Selection

SKU	Cabinet Color	Description
A009-9601	Platinum	4009 IDNAC Repeater with cabinet; provides a single 3 A IDNAC SLC output, 200 mA auxiliary power output, and battery charger; 120/240 VAC, 50/60 Hz input, auto-select
A009-9602	Red	

Table 1: Aftermarket Accessories (installed on-site, select per system requirements)

SKU	Description
A009-9814	Class A Adapter Module, mounts on repeater controller board; required for Class A output
A2975-9813	Platinum semi-flush box trim
A2975-9812	Red semi-flush box trim

Table 2: External Accessories (select per system requirements)

SKU	Description	Comments
A4905-9929	Remote TrueAlert Communications Isolator	Refer to data sheet AC4905-0001 for details
A009-9801	External Battery Cabinet for 25 Ah batteries	16 1/4" W x 13 1/2" H x 5 3/4" D (413 mm x 343 mm x 146 mm); refer to data sheet AC2081-0006 for details

Table 3: Battery Selection (select battery size per system requirements; two batteries are required for 24 VDC operation)

SKU	Description
2081-9272	2081-9274
2081-9274	10 Ah Battery, 12 VDC
2081-9275	18 Ah Battery, 12 VDC

Requires A009-9801 External Battery Cabinet

Wiring Reference, Class B Input with Class B Branch Circuit Outputs


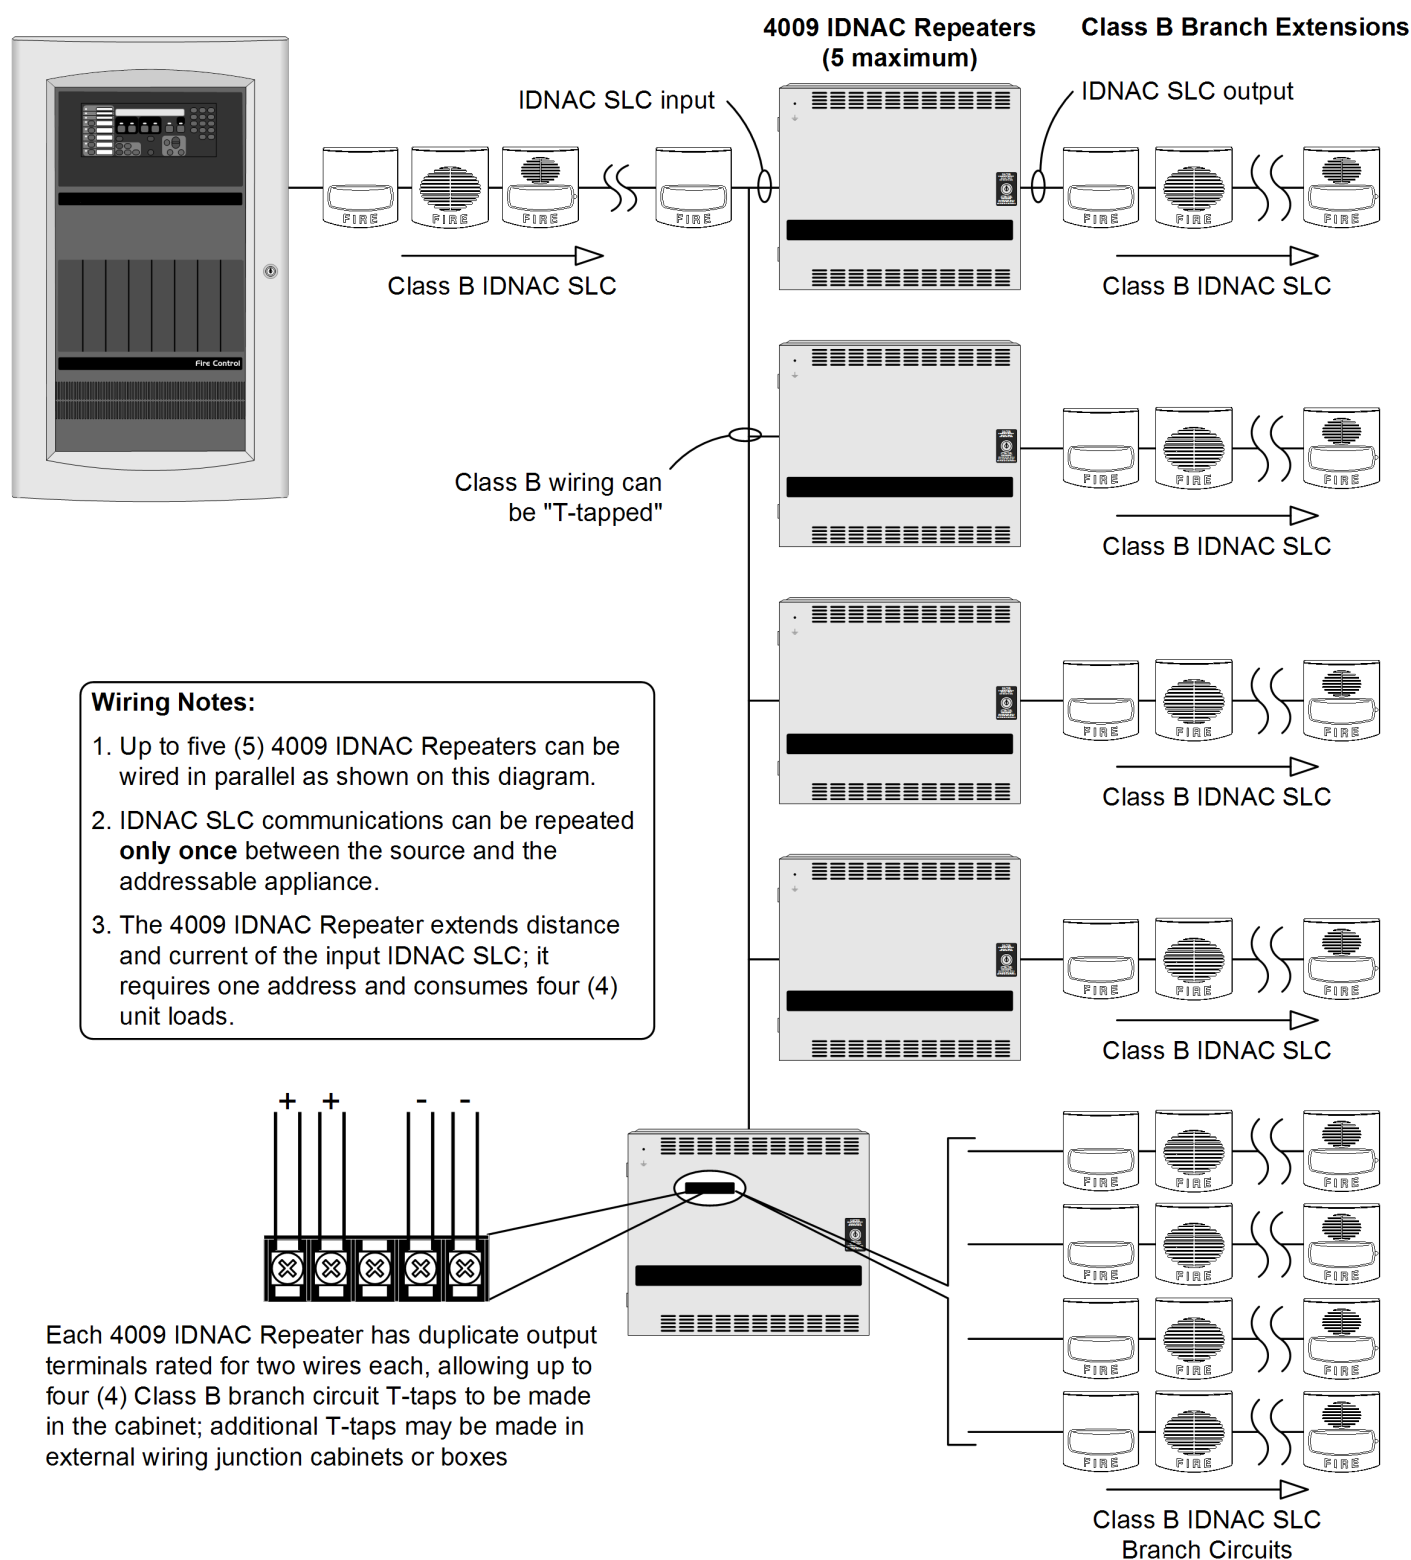


Figure 2: Wiring Reference

Wiring Reference, Class A Loop Extension

Class A IDNAC SLC Loop with 4009 IDNAC Repeater Extending Loop Range and Power

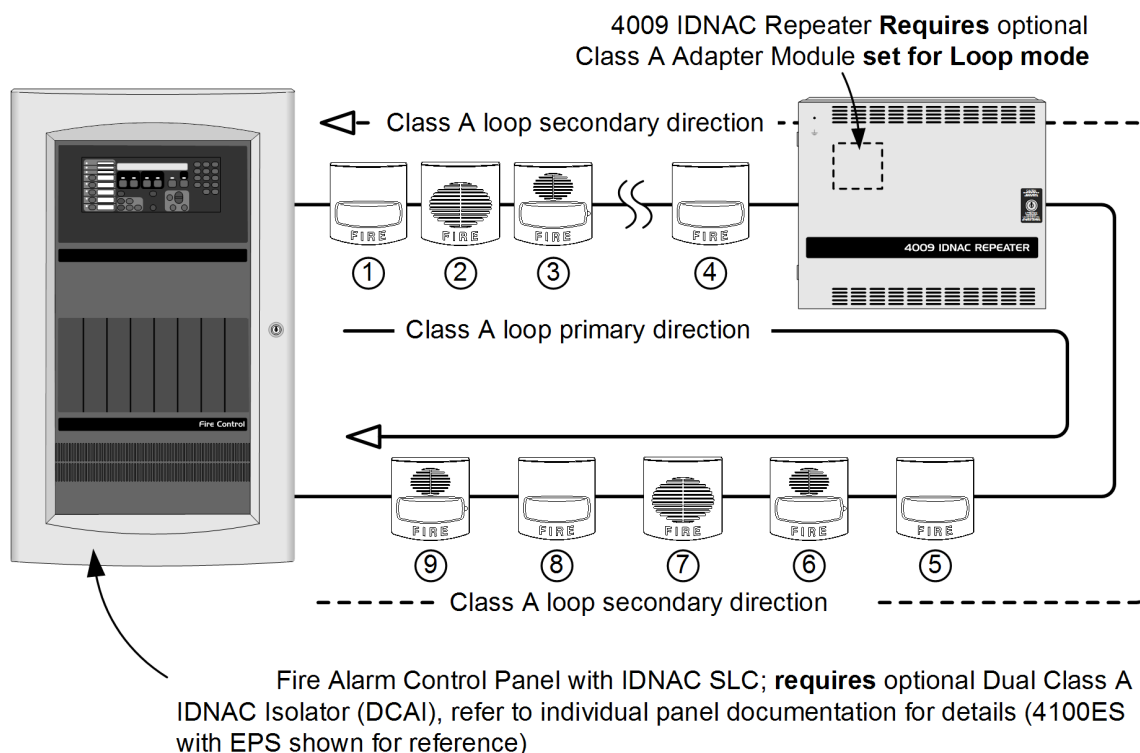

Notes:

1. Only one 4009 IDNAC Repeater can be wired in a Class A loop. (IDNAC SLC communications can be repeated **only once** between the source and the addressable appliance.)
2. The 4009 IDNAC Repeater extends distance and current of the Class A IDNAC SLC loop; it requires one address and consumes four (4) unit loads.
3. Under normal operating conditions (no open circuit wiring), appliances 1 through 4 are powered by the Panel Power Supply and appliances 5 through 9 are powered from the 4009 IDNAC Repeater.
4. Under open circuit conditions, an open circuit in the panel side of the primary path will result in the Panel Power Supply powering appliances 5 through 9 and the 4009 IDNAC Repeater will receive IDNAC SLC input from the return path and then power appliances 1 through 4, or as many as remain connected.

Figure 3: Wiring Reference

Wiring Reference, Class A Riser Input with Class A Loop and Class B Branch Outputs

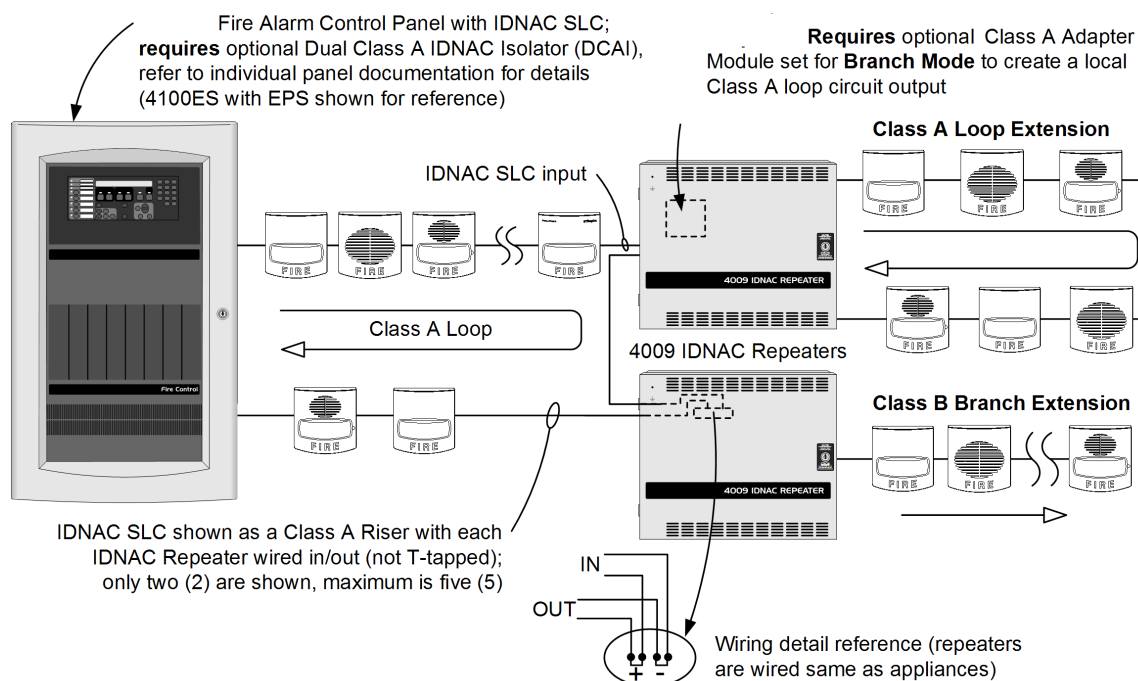


Figure 4: Wiring Reference

4009 IDNAC Repeater Mounting and Module Placement Reference

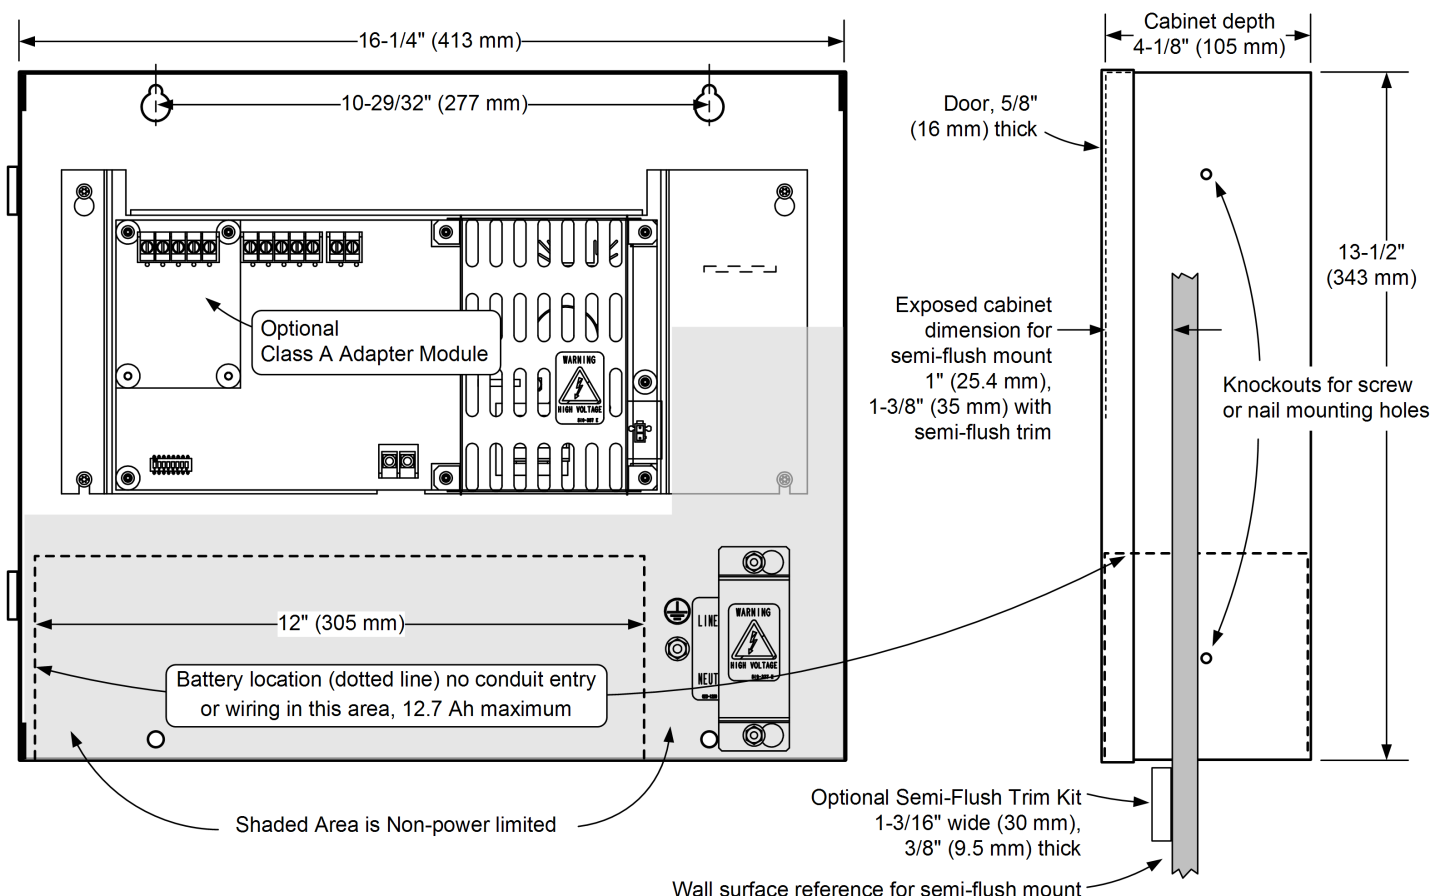


Figure 5: Placement Reference

4009 IDNAC Repeater Specifications

Table 4: Input Ratings

Specification	Rating
Voltage Range	120 VAC, 50/60 Hz, or 220/230/240 VAC, 50/60 Hz, +10%, -15%, auto-select
120 VAC Current	2.5 A
220/230/240 VAC Current	1.25 A
IDNAC Input Ratings	17 VDC minimum
	1 address, 4 unit loads

Table 5: 24 VDC Requirements for Battery Calculations

	Panel	IDNAC Appliances	Auxiliary Load
Standby Currents	70 mA	0.8 mA each	Output current (voltage is from battery)
Alarm Currents	96 mA	4.5 A maximum with 3 A IDNAC SLC load and 200 mA Auxiliary output load (actual alarm current depends on connected and activated appliances and devices)	1.37 x output current (voltage converter is on when in Alarm)

Table 6: Output Ratings

Specification	Rating
IDNAC SLC Output	3 A maximum @ 29 VDC for Special Application appliances
Compatible Special Application Appliances	Autocall TrueAlert ES and TrueAlert addressable notification appliances; contact your Autocall product representative for compatible appliances
IDNAC Repeater Loading and SLC Address Usage	Each repeater uses four unit loads on the EPS it receives power from and supports up to 139 additional unit loads. Most appliances are 1 unit load; Multi-Tone appliances are 2 unit loads; Repeaters and Isolators are 4 unit loads. Refer to individual appliance and device specifications for unit load requirements and rated SLC loading specifications.
	Each repeater uses one IDNAC SLC device address - the IDNAC Repeater does not increase the IDNAC channel device address capacity. Refer to the Host IDNAC SLC specifications for the device address capacity specifications on the IDNAC channel.
Auxiliary Output	Current 200 mA maximum
	Voltage 29 VDC nominal with AC present or when Repeater is on battery standby and in Alarm 24 VDC nominal when on battery standby and not in Alarm

Table 7: IDNAC SLC Wiring Specifications (refer to installation instructions for more information)

Specification	Rating
Recommended wire type	UTP, unshielded twisted pair
Maximum wire length allowed with "T-Taps" for class B wiring	10,000 ft (3048 m)
Maximum wire length to any appliance	4000 ft (1219 m)
Wiring Connections	Terminal blocks for 18 to 12 AWG

Table 8: Repeater Status Indicators

Specification	Rating
Green AC Power LED	On with AC present, off during brownout or no AC condition
Red Communications LED (COMM)	Blinks when Repeater is communicating with the host control panel
Yellow System Status LEDs	4 LEDs provide up to 16 different trouble status indications; an on-board trouble scroll button allows review should multiple troubles occur

Table 9: A009-9814 Class A Adapter Module Option (required for Class A loop extension or for Class A output)

Specifications	Rating
IDNAC SLC Output Voltage	3 A maximum @ 29 VDC for Special Applications appliances
Status LEDs	Two connections, Port A and Port B, function varies by application (loop extension or local loop), Port A and Port B are isolated from each other

Table 10: Environmental and Technical Publications Reference

Specification	Rating
Operating Temperature	32 °F to 120 °F (0 °C to 49 °C)

Table 10: Environmental and Technical Publications Reference

Specification		Rating
Operating Humidity Range		Up to 93% RH at 90 °F (32 °C)
Installation Instructions	4009 IDNAC Repeater	579-1019AC
	Class A Adapter Module	579-1080AC

