

## Features



**Figure 1: 1-Bay 4010ES Fire Control Panel**

### Basic System includes:

- Capacity for up to 998 addressable IDNet points, or up to 1000 addressable MX Loop points and up to 127 VESDA SLI points, with up to 2000 points of Annunciation and up to 20 internal and external card addresses
- Color-coded operator interface with 2 x 40 Super-twist LCD display and programmable control keys and LEDs
- CPU assembly includes dedicated compact flash memory for on-site system information storage and convenient Ethernet service port access
- 8 A power supply with up to 2 A of Auxiliary power and battery charger capacity for up to 110 Ah batteries (UL) or up to 50 Ah batteries (ULC) (33 Ah max in single bay control cabinet, 50 Ah max with A100-0650 battery shelf in two bay control cabinet)
- 4 on-board Class A or B, 3 A NACs and one programmable auxiliary relay output rated for 2 A @ 32 VDC
- Remote annunciator module support via RUI (Remote Unit Interface) communications port, either Class B or Class A operation
- 48 LED Control Unit mount annunciation provides 40 Red and 8 Yellow pluggable LEDs (select models), optional LED kits are available for custom LED configurations
- Available with InfoAlarm Command Center expanded content user interface (two bay cabinet required)

### Optional Main System Supply and door mounted modules, and other options include:

- City Connect (with or without disconnect switches)
- Alarm Relay Module
- Battery brackets for seismic area protection

### Optional block space modules include:

- Fire Alarm Network Interface Card for 4100 Peer-to-Peer network communications, supports either Class B or Class X operation

- Ethernet connectivity options include Building Network Interface Module (BNIC), SafeLINC Internet Interface, and BACpac Ethernet Portal
- Dual RS-232 Module (for printer, PC annunciator or third party interface)
- VESDA Air Aspiration High Level Interface
- Serial DACT
- 8 Zone IDC Modules Class A or B
- 4 Point Auxiliary Relay Module
- Modem or TCP/IP Physical Bridge Network Modules, Class B or Class X
- Additional IDNet and MX Loop addressable channels
- 8-point zone/relay module, each point is selectable as an IDC input or relay output. Class A IDCs require 2 points (one out and one return). Relays rated for 2 A @ 30 VDC (resistive). Configurable as normally open or closed.

### Compatible with Autocall remotely located:

- IP communicator compatibility
- A4606-9102 Remote LCD Annunciator and A602 Series Status Command Units (SCU) and Remote Command Units (RCU) Annunciators
- A190 Series Fiber Modems and Physical Bridges
- A190 Series PC Annunciator
- A4081 Series, 110 Ah Battery Chargers
- 4009 IDNet NAC Extenders (4009A)

## Introduction

### Leading edge installation, operator, and service features

4010ES Series Fire Detection and Control Units provide leading edge installation, operator, and service features for customer applications in the mid-range addressable fire alarm systems market. An on-board Ethernet port provides fast external system communications to expedite installation and service activity. Dedicated compact flash memory archiving provides secure on-site system information storage of electronic job configuration files to meet NFPA 72 (*National Fire Alarm and Signaling Code*) requirements.

### Modular design

A variety of functional modules are available to meet specific system requirements. Selections allow control units to be configured for either Stand-Alone or Networked fire control operation.

## Mechanical Description

- Mounting box provides convenient stud markers for drywall thickness and nail-hole knockouts for quicker mounting
- Smooth box surfaces are provided for locally cutting conduit entrance holes exactly where required
- The hinged User Interface Control Unit easily opens for internal access
- NACs are mounted directly on power supply assemblies providing minimized wiring loss, compact size, and readily accessible terminations
- Modules are power-limited (except as noted, such as relay modules)
- Doors include tempered glass inserts, boxes and doors are available in platinum or red
- Box and door/retainer assemblies are included with basic control unit assemblies
- Cabinet assembly is rated NEMA 1 and IP 30
- Cabinet assembly design has been seismic tested and is certified to IBC and CBC standards as well as to ASCE 7 categories A through F,

## 4010ES Addressable Fire Detection and Control Basic Control Unit Modules and Accessories

requires battery brackets as detailed on data sheet **AC2081-0019**

### Control Unit Hardware

#### Master Controller and Main System Supply

Mounted in the upper section of the 4010ES cabinet.

#### 4010ES Block Space Option Cards

4010ES Block Space Option Cards mount to the left of the 4010ES Main System Supply. In 2-bay cabinets block space option cards also mount below the 4010ES ESS.

#### Other 4010ES Options:

The 4010ES City Connect module or the optional Alarm Relay module mount directly to the Main System Supply. These options are mutually exclusive.

Network Media modules mount directly to the 4010ES Network Interface Card.

The Battery Compartment located in the bottom of the 4010ES cabinet accepts two batteries without interfering with expansion module space.

### Software Feature Summary

- TrueAlarm individual analog sensing with front panel information and selection access
- "Dirty" TrueAlarm sensor maintenance alerts, service and status reports including "almost dirty"
- TrueAlarm magnet test indication appears as distinct "test abnormal" message on display when in test mode
- TrueAlarm sensor peak value performance report
- Install Mode allows grouping of multiple troubles for uninstalled modules and devices into a single trouble condition (typical with future phased expansion); with future equipment and devices grouped into a single trouble, operators can more clearly identify events from the commissioned and occupied areas
- Module level ground fault searching assists installation and service by locating and isolating modules with grounded wiring
- Recurring Trouble Filtering allows the control unit to recognize, process, and log recurring intermittent troubles (such as external wiring ground faults), but only sends a single outbound system trouble to avoid nuisance communications
- WALKTEST silent or audible system test performs an automatic self-resetting test cycle

### Compatible Peripheral Devices

The 4010ES is compatible with an extensive list of remote peripheral devices including printers, PC Annunciators and both conventional and addressable devices including TrueAlarm analog sensors.

### Addressable Device Control

The 4010ES provides standard addressable device communications for IDNet compatible devices. Using a two wire communications circuit, individual devices such as manual fire alarm stations, TrueAlarm sensors, conventional IDC zones, and sprinkler waterflow switches can be interfaced to the addressable controller to communicate their identity and status.

Addressability allows the location and condition of the connected device to be displayed on the operator interface LCD and on remote system annunciators. Additionally, control circuits (fans, dampers, etc.) may be individually controlled and monitored with addressable devices.

#### Addressable Operation

Each addressable device on the communication channel is continuously interrogated for status condition such as: normal, off-normal, alarm, supervisory, or trouble. Both Class B and Class A pathway operation are available. Sophisticated poll and response communication techniques ensure supervision integrity and allow for "T-tapping" of the circuit for Class B operation. Devices with LEDs pulse the LED to indicate receipt

of a communications poll and can be turned on steady from the control unit.

#### IDNet Addressable Channel Capacity

The Main System Supply supports up to 248 addressable monitor and control points intermixed on the same pair of wires. Additional 250 address IDNet 2+2 Modules with four short circuit isolating output loops are available. IDNet 2+2 Module SLCs are isolated from other system reference voltages to reduce common mode noise interaction with adjacent system wiring.

**Table 1: IDNet 2 and IDNet 2+2 SLC Wiring Specifications**

Specification		Rating
Maximum Distance from control unit per device load	0 to 125	4000 ft (1219 m); 50 ohms
	126-250	2500 feet (762 m); 35 ohms
Total wire length allowed with "T" taps for Class B wiring		Up to 12,500 ft (3.8 km); 0.60 $\mu$ F
Maximum capacitance between IDNet channels		1 $\mu$ F
Loading per device		0.8 mA supv., 1 mA alarm; 2 mA per activated device LED
Wire type and connections		Shielded or unshielded, twisted or untwisted wire*
Connections		Terminal blocks for 18 to 12 AWG

**Note:** Compatibility includes: IDNet communicating devices and TrueAlarm sensors including QuickConnect and QuickConnect2 sensors.

**Note:** \* Some applications may require shielded wiring. Review your system with your local Autocall product supplier.

### TrueAlarm System Operation

Addressable device communications include operation of TrueAlarm smoke and temperature sensors. Smoke sensors transmit an output value based on their smoke chamber condition and the CPU maintains a current value, peak value, and an average value for each sensor.

Status is determined by comparing the current sensor value to its average value. Tracking this average value as a continuously shifting reference point filters out environmental factors that cause shifts in sensitivity.

#### Programmable sensitivity

The programmable sensitivity of each sensor can be selected at the control unit for different levels of smoke obscuration (shown directly in percent) or for specific heat detection levels. To evaluate whether the sensitivity should be revised, the peak value is stored in memory and can be easily read and compared to the alarm threshold directly in percent.

#### CO sensor bases

CO sensor bases combine an electrolytic CO sensing module with a TrueAlarm analog sensor to provide a single multiple sensing assembly using one system address. The CO sensor can be enabled/disabled, used in LED/Switch modes and custom control, and can be made public for communication across a fire alarm Network. Refer to data sheet **AC4098-0052** for details.

#### TrueAlarm heat sensors

TrueAlarm heat sensors can be selected for fixed temperature detection, with or without rate-of-rise detection. Utility temperature sensing is also available, typically to provide freeze warnings or alert to HVAC system problems. Readings can be selected as either Fahrenheit or Celsius.

#### TrueSense Early Fire Detection

Multi-sensor A4098-9754 provides photoelectric and heat sensor data using a single 4010ES IDNet address. The control unit evaluates smoke activity, heat activity, and their combination, to provide TrueSense early detection. For more details on this operation, refer to data sheet **AC4098-0024**.

## Diagnostics and Default Device Type

### Sensor Status

TrueAlarm operation allows the control unit to automatically indicate when a sensor is almost dirty, dirty, and excessively dirty. The NFPA 72 requirement for a test of the sensitivity range of the sensors is fulfilled by the ability of TrueAlarm operation to maintain the sensitivity level of each sensor. CO Sensors track their 10 year active life status providing indicators to assist with service planning. Indicators occur at: 1 year, 6 months, and when end of life is reached.

### Modular TrueAlarm sensors

Modular TrueAlarm sensors use the same base and different sensor types (smoke or heat sensor) and can be easily interchanged to meet specific location requirements. This allows intentional sensor substitution during building construction when conditions are temporarily dusty. Instead of covering smoke sensors (causing them to be disabled), heat sensors may be installed without reprogramming the control unit. The control unit will indicate an incorrect sensor type, but the heat sensor will operate at a default sensitivity to provide heat detection for building protection at that location.

## Master Controller (CPU)

- The 4010ES Master Controller includes dedicated 2GB compact flash Mass Storage memory for on-site system information storage and convenient Ethernet service port access
- Convenient front panel accessed Ethernet port for quick and easy download of site-specific programming
- Firmware enhancements are made via software downloads to the on-board flash memory
- Every downloaded job is automatically stored to Compact flash without overwriting earlier versions providing a means for recovering previous configurations
- Downtime is reduced because the system stays running during download
- Modifications can be uploaded as well as downloaded for greater service flexibility
- Mass Storage allows job specific files to be stored in the control unit such as test and inspection reports, record drawings, specifications, and more...
- Ethernet connectivity options include Building Network Interface Module (BNIC) and SafeLINC Internet Interface
- RUI (Remote Unit Interface) communications port supports either Class B or Class A operation for remote annunciation equipment

## Basic Control Unit Description

4010ES Control Units include:

An operator interface, master controller with 2GB compact flash, IDNet or MX Loop addressable device SLC(s) with short circuit isolating loops configurable for Class B or Class A operation

8 A power supply with up to 2 A of auxiliary power, 110 Ah (UL)/50 Ah (ULC) battery charger (33 Ah max in 1 bay cabinet, 50 Ah max with A100-0650 battery shelf in two bay control cabinet); 4 Class A or Class B NACs rated @ 3 A each for Special Application Appliances, selectable for synchronized strobe, or SmartSync horn/strobe operation over two wires; and 2 A for Regulated 24 DC operation; 1 programmable auxiliary relay rated for 2 A @ 32 VDC

1 RUI Class B or Class A communications port for remote annunciation devices, cabinet and door.

Support for up to 20 internal and external card addresses. Other standard options may be provided depending on model (see basic control unit model selection below for additional details on specific models).


## 8-Point Zone/Relay Module Details

- Select as IDC or Relay; configure up to 8, Class B IDCs, or up to 4, Class A IDCs; or up to 8, Relay outputs rated 2 A resistive @ 30 VDC (N.O. or N.C.); or combinations of IDCs and Relays; each zone is separately configurable as an IDC or Relay output
- IDC Support: each IDC supports up to 30, two-wire devices. Zone relay modules may be powered directly from the control unit power supply or through the optional 25 VDC regulator module where required for 2-wire detector compatibility (refer to 2-Wire Detector Compatibility document 579-832 for additional details).
- IDC EOL resistor values are selectable as: 3.3 k $\Omega$ , 2 k $\Omega$ , 2.2 k $\Omega$ , 3.4 k $\Omega$ , 3.9 k $\Omega$ , 4.7 k $\Omega$ , 5.1 k $\Omega$ , 5.6 k $\Omega$ , 6.34/6.8 k $\Omega$ , and 3.6 k $\Omega$  + 1.1 k $\Omega$ ; see instructions for more details

## Main System Supply

The main system supply provides the power source and the input/output connections for the basic 4010ES control unit. The main features are listed in the basic control unit description.

## Operator Interface Features

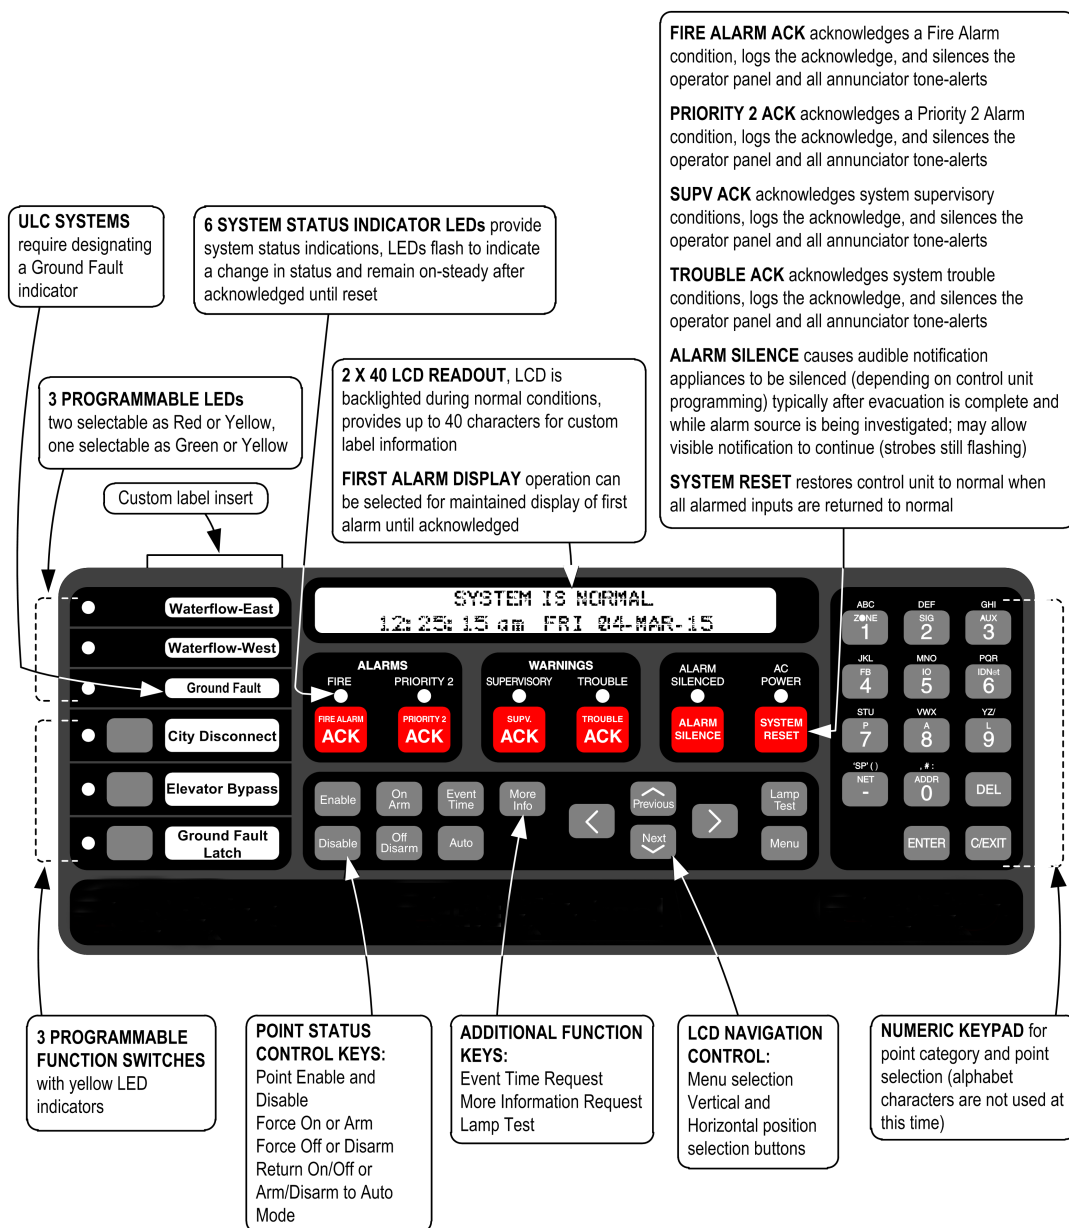

**Figure 2: Operator Interface Features**

### Operator Interface Features

- Convenient and extensive operator information is provided using a logical, menu-driven display
- Multiple automatic and manual diagnostics for maintenance reduction
- Convenient PC programmer label editing
- Password access control
- Alarm and Trouble History Logs (up to 2000 total events) are available for viewing from the LCD, or capable of being printed to a connected printer, or downloaded to a service computer

### Convenient Status Information

With the locking door closed, the glass window allows viewing of the display, status LEDs, and available operator switches. Features include a two-line by 40-character, wide viewing angle (super-twist) LCD with status LEDs and switches as shown.

LED indicators describe the general category of activity being displayed with the LCD providing more detail. For the authorized user, unlocking the door provides access to the control switches and allows further inquiry by scrolling the display for additional detail.

## 4010ES Addressable Fire Detection and Control Basic Control Unit Modules and Accessories

### Basic Control Unit Model Selection - 1 Bay Control Units

Supervisory and Alarm current specifications are for determining battery standby requirements. Current specifications include an active RUI channel. Models with an IDNet channel include 20 IDNet device LEDs activated in alarm. Models with MX communications include module base current. Actual IDNet or MX channel device current is not included, refer to [Addressable Device Load Specifications for Battery Standby](#) for details. For models with 48 LED Annunciation, alarm also includes 24 LEDs activated.

SKU	Control Unit Color	Language & Voltage	Listing	Features	Supv. Current	Alarm Current	Available Option Blocks
A010-9502BA	Platinum	English 220 - 240 VAC	UL, ULC	Basic Control Unit with 2x40 LCD Operator Interface and (1) Two-loop Isolated IDNet+ Communications Channel, Class A or Class B operation, with support for up to 248 addressable IDNet points	316 mA	430 mA	3 4"x5" blocks

**Note:** Model numbers ending in BA are assembled in the USA.

### Basic Control Unit Model Selection - 2 Bay Control Units

Supervisory and Alarm current specifications are for determining battery standby requirements. Current specifications include an active RUI channel. Models with IDNet channels include 20 IDNet device LEDs activated in alarm per channel. Models with MX communications include unloaded module current only. Actual IDNet or MX channel device current is not included, refer to [Addressable Device Load Specifications for Battery Standby](#) for details.

SKU	Control Unit Color	Language & Voltage	Listings	Features	Available Option Blocks	Supv. Current	Alarm Current
A010-9421 A010-9421BA	Red	English 120 VAC	UL, ULC	Basic Control Unit with 2x40 Operator Interface, (1) Two-loop isolated IDNet+ Communications Channel and (1) Four-loop Isolated IDNet 2+2 Communications Channel Module, Class A or Class B operation, with support for up to 498 addressable IDNet points	10 4"x5" blocks	391 mA	545 mA
A010-9422 A010-9422BA	Platinum	English 120 VAC	UL, ULC	Basic Control Unit with 2x40 Operator Interface, (1) Two-loop isolated IDNet+ Communications Channel and (1) Four-loop Isolated IDNet 2+2 Communications Channel Module, Class A or Class B operation, with support for up to 498 addressable IDNet points	10 4"x5" blocks	391 mA	545 mA
A010-9425 A010-9425BA	Red	English 120 VAC	UL, ULC	Same as A010-9422(BA) except with InfoAlarm Operator Interface	10 4"x5" blocks	398 mA	496 mA
A010-9426 A010-9426BA	Platinum	English 120 VAC	UL, ULC	Same as A010-9422(BA) except with InfoAlarm Operator Interface	10 4"x5" blocks	398 mA	496 mA
A010-9526BA	Platinum	English 220 - 240 VAC	UL, ULC	Basic Control Unit with InfoAlarm Operator Interface, with (1) Two-loop isolated IDNet + Communications Channel for up to 248 addressable IDNet Points	11 4"x5" blocks	509 mA	366 mA

**Note:** Model numbers ending in BA are assembled in the USA.



## Addressable Device Load Specifications for Battery Standby

Addressable Channel	Device Load	Supervisory Current	Alarm Current
IDNet+ and IDNet 2+2 Channel Device Currents (20 device LEDs in alarm are included with control unit and module currents)	With 250 Devices Add	200 mA	250 mA
	With 125 Devices Add	100 mA	125 mA
	With 50 Devices Add	40 mA	50 mA
Supervisory = 0.8 mA per device Alarm = 1 mA per device			
MX Loop Card	With 250 devices Add	1.135 A	1.135 A
25V Regulator for MX Loop	4 A output Alarm, 2.5 A Standby Add	4.68 A	3.0 A
	3.5 A output Alarm, 2.0 A Standby Add	4.2 A	2.4 A
	3.0 A output Alarm, 1.5 A Standby Add	3.6 A	1.8 A
	2.5 A output Alarm, 1.0 A Standby Add	2.87 A	1.2 A
	2.0 A output Alarm, 0.5 A Standby Add	2.4 A	630 mA

## Block Space Option Card Selection

Refer to diagrams for option module availability. Supervisory and Alarm current specifications consider no load on addressable channels except as noted (see addressable device load specifications for device load battery standby).

**Table 2: Single Block Option Modules**

SKU	Features	Supervisory Current	Alarm Current	Option Block Usage
A010-9912	Serial DACT; Note: Must mount in Block D under Main System Supply	30 mA	40 mA	1 Block (must mount in top bay, block D)
A010-9908	4 Point Aux Relay Module	15 mA	60 mA	1 Block (3 maximum)
A010-9916	Voltage Regulator Module, 22.8 to 26.4 VDC (25 VDC nominal); isolated and resettable output; includes earth detection circuit and trouble relay for status monitoring	3 A maximum with 2.5 A load	4.9 A maximum with 4 A load	1 Block (1 maximum)
A010-9918	Dual RS-232 Module	60 mA	60 mA	1 Block (3 maximum)
A100-5013	8 point zone/relay 4x5" flat module. Mounts in any open block in a master controller or expansion bay. Alarm current shown is for 8 Class B IDCs using 3.3K end-of-line-resistors with 4 in alarm and 4 in standby. Standby current shown is for all 8 IDCs in standby. Refer to 579-1236AC Zone/Relay Module Installation Instructions for additional information.	1 block	83 mA	351 mA
A100-6305	5 25V regulator harness for 8 point zone/relay module. One required for each 8 point zone/relay module to be powered by the A100-5130 25V regulator module. A maximum of (5) 8 point zone/relay modules may be powered from the A100-5130 per bay.	N/A	N/A	N/A
A010-9929	IDNet 2+2 Module, 250 point capacity; electrically isolated output with four short circuit isolating Class B or Class A output loops; alarm currents for 50 and above devices includes 20 device LEDs in alarm; see page 6 for individual device currents	No device	50 mA	1 Block (3 maximum)
		50 devices	90 mA	
		125 devices	150 mA	
		250 devices	250 mA	

## 4010ES Addressable Fire Detection and Control Basic Control Unit Modules and Accessories

**Table 3: Dual Vertical Block (Flat) Modules**

SKU	Features	Option Block Usage	Supervisory Current	Alarm
A010-9928	For 1-Bay Control Units Only: Dual Vertical Block Card Mounting Kit, allows selecting two, dual Vertical Block (flat) modules from the list below; mounts at right angle to chassis (note block usage details)	2 Vertical Blocks (mounts in top bay, block space A & B only)	NA	NA
A010-9922	Modular Network Interface Card (requires two media cards from below)	2 Vertical Blocks	30 mA	30 mA
A010-9818	Network Media Card Wired	N/A (mounts to A010-9922)	55 mA	55 mA
A010-9819	Network Media Card Fiber Optic		25 mA	25 mA
A010-9926**	TCP/IP Physical Bridge Class B	3 Block "L" Shape, requires 2 Vertical Blocks, plus adjacent right side lower Block (D, F, or H)	196 mA	196 mA

**Table 4: Additional Option Modules with Special Option Block Usage**

SKU	Features	Option Block Usage	Supervisory Current	Alarm
A010-9917	MX Loop Card supports up to 250 points	2 Vertical Blocks (not compatible with A010-9928)	100 mA (no devices)	100 mA (no devices)

**Note:** \* UL, ULC, and CSFM Listed.

**Note:** \*\* FM Approved only.

**Table 5: Additional Control Unit Feature Selection (block space is not used)**

SKU	Features	Supervisory Current	Alarm Current	Mounting Requirements
A010-9909	City Connect Module w/ disconnect switches	20 mA	36 mA	Select one maximum, mounts on Main System Supply, only one
A010-9911	Alarm Relay Module	15 mA	37 mA	Select one maximum, mounts on Main System Supply, only one
A100-5128	Battery Distribution Terminal Block, mounts to side of box, required when battery connection leaves the 4010ES box (also used in the 4100ES fire alarm control unit)			

### Additional Control Unit Feature Selection (block space is not used)

**Table 6: Additional Control Unit Features**

SKU	Features	Supervisory Current	Alarm Current	Mounting Requirements
A010-9909	City Connect Module w/ disconnect switches	20 mA	36 mA	Select one maximum, mounts on Main System Supply, only one
A010-9911	Alarm Relay Module	15 mA	37 mA	
A100-5128	Battery Distribution Terminal Block, mounts to side of box, required when battery connection leaves the 4010ES box (also used in the 4100ES fire alarm control unit)			

## Cabinet Dimension Reference

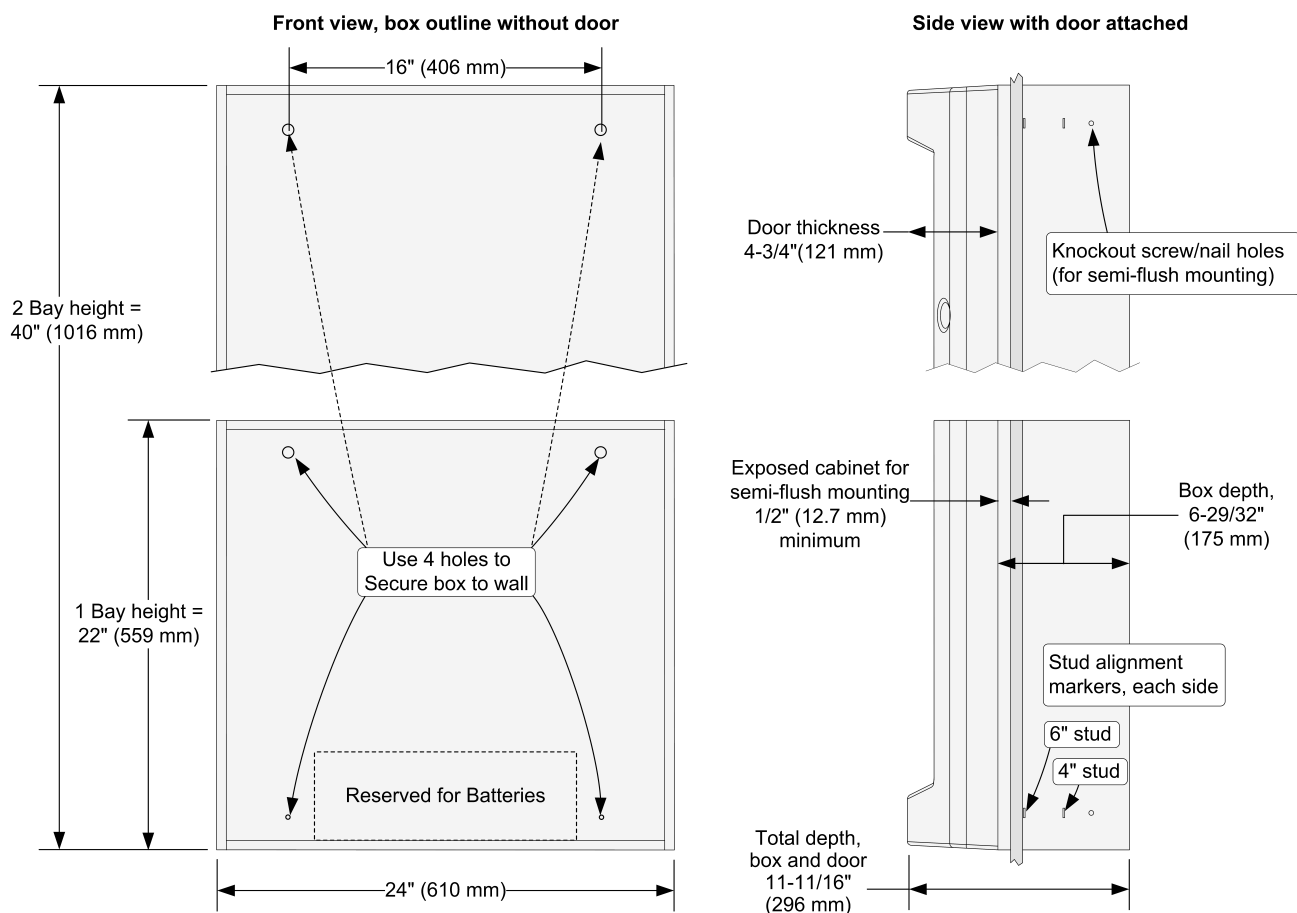


Figure 3: Cabinet Dimension Reference

## Cabinet One and Two Bay Loading Reference

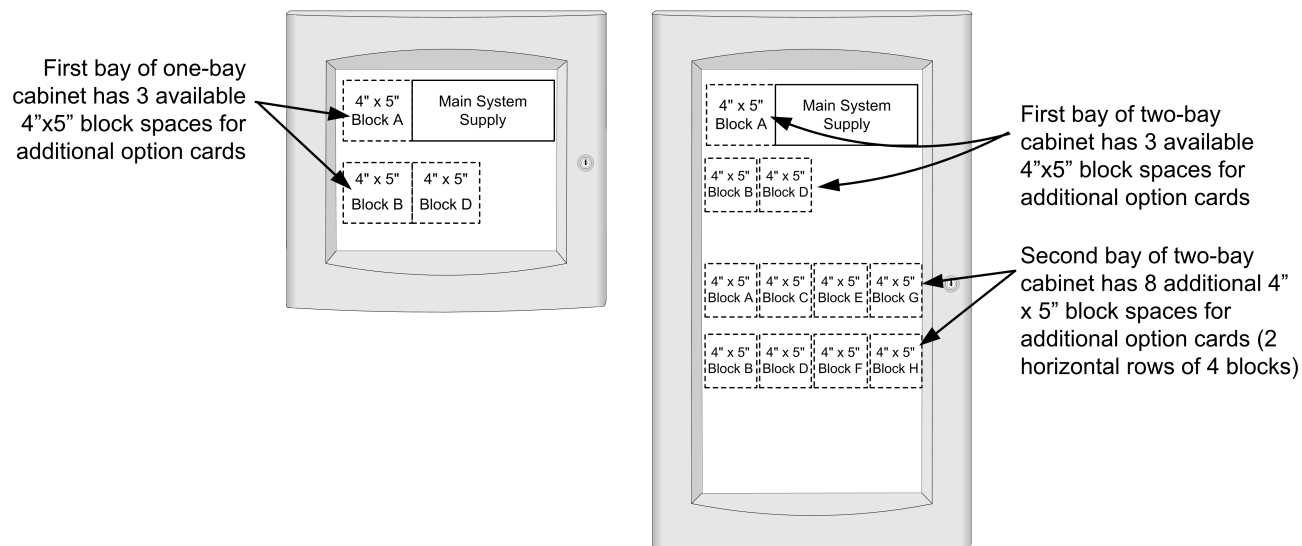


Figure 4: Loading Reference

**Note:** Some spaces may be used by basic control unit features.



## Miscellaneous Accessories

**Table 7: End User and Factory Programming Tools**

SKU	Description
A100-8802	End User Programming Unit Software
4010-8810	Factory Programming (select)

**Table 8: LED Kits (LEDs are pluggable, use to change color for local application requirements)**

SKU	Description
4100-9843	8 Yellow LED Kit
4100-9844	8 Green LED Kit
4100-9845	8 Red LED Kit
4100-9855	8 Blue LED Kit

## Additional Compatible Equipment and Reference

**Table 9: Additional Compatible Equipment and Reference**

Subject	Data Sheet
Agent Release Accessories	AC2080-0010
Serial DACT (SDACT)	AC2080-0009
MX Loop Interface Module	AC4100-0059
TCP/IP Physical Bridge	AC4100-0029
Graphic I/O Modules	AC4100-0005
110 Ah Batteries & Cabinets	AC2081-0012
4009 IDNet NAC Extender	AC4009-0002
BACpac Ethernet Module	AC4100-0051
A602 Series SCU/RCU	AC4602-0001
A4606-9102 Remote LCD Annunciator	AC4606-0002
Remote Battery Charger	AC4081-0002
Network Physical Bridge	AC4100-0057
Interface to VESDA Air Aspiration Detection Systems	AC4100-0026
120 VAC Remote Printer	AC4190-0011
PC Annunciator	AC4190-0013
Multi-Signal Fiber Optics	AC4100-0049
SafeLINC Internet Interface	AC4100-0062

## General Specifications

**Table 10: General Specifications**

Specification	Rating		
AC Input Current	120 VAC Models	4 A maximum, 120 VAC @ 60 Hz nominal	
	220-240 VAC Models	2 A maximum, 220/230/240 VAC @ 50 or 60 Hz	
	Battery	9 A maximum @ 24VDC (during battery operation)	
Power Supply Output Ratings (nominal 28 VDC on AC, 24 VDC on battery backup)	Total Power Supply Output Rating	Including module currents and auxiliary power outputs; 8 A total for "Special Application" appliances; 4 A total for "Regulated 24 DC" power (see below for details)	Output switches to battery backup during mains AC failure or brownout conditions
	Auxiliary Power Tap	2 A maximum, rated 19.1 to 31.1 VDC	
Special Application Appliances, maximum of 70 appliances per NAC	Autocall 4901, 4903, 4904, and A4906 Series horns, strobes, and combination horn/strobes and speaker/strobes (contact your Autocall product representative for compatible appliances)		
Regulated 24 DC Appliances	Power for other UL listed appliances; use associated external synchronization modules where required		
Battery Charger Rating (sealed lead acid batteries)	Battery capacity range	Battery charging of 6.2 Ah up to 50 Ah or 110 Ah batteries. For 2 bay cabinets, battery capacity above 50 Ah requires a separate cabinet.  See data sheet AC2081-0012 for further details.	
	Charger characteristics and performance	Temperature compensated, dual rate, recharges depleted batteries within 48 hours per UL Standard 864; to 70% capacity in 12 hours per ULC Standard S527	
Environmental	Operating Temperature	32 °F to 120 °F (0 °C to 49 °C)	
	Operating Humidity	Up to 93% RH, non-condensing @ 90 °F (32 °C) maximum	

## 4010ES Addressable Fire Detection and Control Basic Control Unit Modules and Accessories

**Table 10: General Specifications**

Specification	Rating	
<b>Additional Technical Reference</b>	Installation Instructions	579-989AC
	Operating Instructions	579-969AC

## 4010ES Addressable Fire Detection and Control Basic Control Unit Modules and Accessories

### 4010ES Card Address Allocation

The 4010ES has a maximum internal and external card address limit of 20 card addresses. Use the table below to calculate 4010ES card address allocation.

1. For the applicable control unit, write in the Card Address Consumption value in the Card Address Allocation column. Select 1 control unit only.
2. For the option cards to be installed on the 4010ES, write in the Card Address Consumption value in the Card Address Allocation column.
3. Total the Card Address Allocation column (total must not exceed 20).

SKU	Description	Card Address Consumption	Card Address Allocation
<b>Control Units (Select One)</b>			
A010-9502BA	2x40 Display, (1) IDNet+ Communications Channel; or (1) MX Channel, 1-Bay Box	2	
A010-9421	2x40 Display, (1) IDNet+ Communications Channels and (1) IDNet 2+2 Communications Channel; or 2 MX Communications Channels, 2-Bay Box	3	
A010-9422	2x40 Display, (1) IDNet+ Communications Channels and (1) IDNet 2+2 Communications Channel; or 2 MX Communications Channels, 2-Bay Box	3	
A010-9422BA	2x40 Display, (1) IDNet+ Communications Channels and (1) IDNet 2+2 Communications Channel; or 2 MX Communications Channels, 2-Bay Box	3	
A010-9425	InfoAlarm Display, (1) IDNet+ and (1) IDNet 2+2 Communications Channel, 2-Bay Box	4	
A010-9425	InfoAlarm Display, (1) IDNet+ and (1) IDNet 2+2 Communications Channel, 2-Bay Box	4	
A010-9426	InfoAlarm Display, (1) IDNet+ and (1) IDNet 2+2 Communications Channel, 2-Bay Box	4	
Note: Products with suffix "BA" are assembled in the USA			
<b>Control Unit Option Cards (Select As Required)</b>			
A010-9922	Flat Network Card	1	
A010-9908	4 Point Flat Aux Relay Module	1	
A010-9912	Serial DACT	1	
A010-9917	MX Loop Card	1	
A010-9918	Dual RS-232 Module	1	
A010-9929	IDNet 2+2 Communications Module	1	
<b>Remote Annunciation (Select As Required)</b>			
A100-9401	Remote Red Cabinet, English	2	
A100-9403	InfoAlarm Platinum Cabinet, English	2	
A100-9441	Command Red Cabinet, with blank inserts for key labels	2	
A100-9443	Center Platinum Cabinet, with blank inserts for key labels	2	
A4606-9102	4010ES RUI LCD Annunciator, English	1	
A4606-9102	4010ES RUI LCD Annunciator, English	1	
A4606-9102	4010ES RUI LCD Annunciator, French	1	
A602-9101	Status Command Unit (SCU) LED Annunciator	1	
A602-9102	Remote Command Unit (RCU) LED Annunciator w/control	1	
A602-9150	Graphic I/O RCU/SCU Assembly for custom annunciator Control Units	1	
A602-7101	Graphic I/O RCU/SCU Assembly for custom annunciator Control Units	1	
A602-7001	RCU for cabinet mount	1	
A602-6001	SCU for cabinet mount	1	
A100-7401	24 Point I/O Graphic Module (requires mounting cabinet)	1	
A100-7402	64/64 LED Switch Controller for custom annunciator Control Units	1	
A100-7403	32 Point LED Driver Module for custom annunciator Control Units	1	
A100-7404	32 Point Switch Input Module for custom annunciator Control Units	1	
<b>Total Card Addresses (Not to Exceed 20)</b>		<b>TOTAL</b>	

