

Non-Addressable Initiating Peripherals

E-Series Electronic Heat Detectors for Extended Exposure to High Humidity

Features

Accurate and reliable heat detection for protection of property** UL listed to Standard 521 as a rate compensated heat detector Fixed temperature operation is suitable for most applications:

- Thermistor based design is inherently rate compensated due to minimal thermal lag
- Available for 135° F (57° C) or 200° F (93° C)
- UL spacing distance is 70 ft (21.3 m)
- Available with rate-of-rise temperature detection:
- Dual thermistor rate-of-rise operation
- \cdot For use where anticipated ambient temperature changes are less than 6° F/minute (3.33° C/minute)
- UL spacing distance is 70 ft (21.3 m)

E-Series provides:

- Epoxy encapsulated electronic detector design with gold plated contacts, high humidity thermistor, and stainless steel screws
- Operation for ceiling or wall mounting
- Easily tested, self-restoring operation with repeatable accuracy
- Alarm indicating LED located on detector
- Current limited alarm that is compatible with two wire initiating device circuits (IDCs)
- Designed for EMI compatibility

Optional remote alarm indicating LED Available base options:

- · Bases for 2-wire or 4-wire operation
- Auxiliary relay output (refer to selection chart on page 2 for relay ratings)
- Remote alarm indicating LED output

Description

Accurate Electronic Design

Autocall electronic heat detectors use a fast response, thermistor based design to provide temperature sensing that quickly, accurately, and consistently identifies when fixed temperatures are exceeded. The fixed temperature sensing thermistor readily tracks the local ambient temperature. This eliminates the time required to melt a lead pellet or heat a bimetallic element as occurs in mechanical heat detector designs and provides the required heat detection for most applications.

Rate-of-rise detection

Rate-of-rise detection is determined by comparing two thermistor responses. By combining accurate thermistors with proper physical placement, this patented rate-of-rise detection design achieves a high level of performance not normally available with mechanical detection.

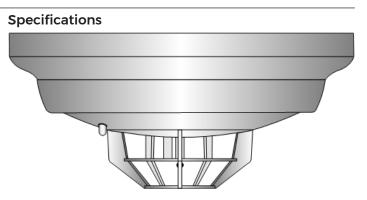


Fig 1: E-Series Electronic Heat Detector Mounted in Base

Specification	Rating	
Voltage	15 to 32 VDC (filtered DC with 30% maximum ripple)	
Standby Current	80 μA typical, 100 μA maximum	
Alarm Current, 2-Wire Operation	Up to 86 mA maximum, exact current is determined by alarm current limiting of connected IDC	
Alarm Current, 4-Wire Operation	24 mA typical @ 24 VDC	
Rate-of-Rise Operation	Meets FM requirements for operation between 15° and 25° F/min (8.33° and 13.88° C/min)	
Color	Frost-White	
Dimensions	Refer to diagram on page 3	
Environmental Operating Range	Suitable for covered outdoor applications within the ambient conditions stated below	
Humidity Range	10% to 95% RH from 32° to 122° F (0° to 50° C)	

Table 1: Ambient Temperature Operating Range

Specification	Rating	
135° F Models	32° to 100° F (0° to 38° C)	
200° F Models	32° to 150° F (0° to 66° C)	

WARNING: ** In most fires, hazardous levels of smoke and toxic gas can build up before a heat detection device would initiate an alarm. In cases where Life Safety is a factor, the use of smoke detection is highly recommended.



Applications Reference

Heat detectors are used where property protection is desired and where life safety protection is not required or is performed by other equipment. Typical heat detector applications are satisfied by use of these fixed temperature electronic detectors.

The addition of rate-of-rise operation provides two forms of heat detection for use where temperature fluctuations are controlled and are less than 6° F/min (3.33° C/min). Where temperatures may fluctuate more quickly, use fixed temperature detection.

Refer to NFPA 72, the National Fire Alarm Code and publication 574-709AC, A4098 Detectors, Sensors, and Bases Application Manual, for additional guidance in applying and locating heat detectors.

E-Series Products

E-Series electronic heat detectors are similar to standard Autocall indoor electronic heat detectors but are equipped with gold plated contacts, a high humidity thermistor, and stainless steel screws. For indoor heat detector applications, refer to data sheet *AC4098-0014*.

Alarm Indicating LED Operation

The heat detector LED turns ON continuously when in alarm. During normal conditions the LED is OFF.

Fixed Temperature Guidelines

135° F (57° C) fixed temperature detectors are for normal temperatures that do not exceed 100° F (38° C). **200° F (93° C)** fixed temperature detectors are for normal temperatures that exceed 100° F (38° C) but are less than 150° F (66° C).

Alarm Verification Application Note

When connecting these electronic heat detectors to a 2-wire initiating device circuit (IDC) that is providing Alarm Verification for smoke detectors, use the A4098-9682E, 4-wire base. The 4-wire base provides an alarm contact that is not current-limited. (Heat detectors in the 2-wire base present a current-limited alarm condition that is not compatible with Alarm Verification. Initiating devices other than smoke detectors are required to activate the alarm without starting the alarm verification cycle.)

Heat Detector Selection Chart (compatible with bases listed below)

Fixed		•	Fm Ratings		UI & Ulc Maximum
SKU	Temperature Operation at		Maximum Spacing	RTI (Response Time Index)	
A4098-9612E	135° F (57° C)	Not applicable	20 ft x 20 ft (6.1 m x 6.1	Ouick	
A4098-9614E	200° F (93° C)		m)	Quick	
A4098-9613E	135° F (57° C)	Between 15° & 25° F/min (8.33° & 13.88° C/min)	20 ft x 20 ft (6.1 m x 6.1 m)	Quick	70 ft x 70 ft (21.3 m x 21.3 m)
A4098-9615E	200° F (93° C)		50 ft x 50 ft (15.2 m x 152 m)	Ultra Fast	-



Heat Detector Base Selection Chart


SKU	Description	Connection	Details	
A4098-9788E	2-Wire Base, no options	IDC connections	Screw terminals for in/out wiring, 18 to 14 AWG	
	2-Wire Base with connection for remote LED alarm indicator	IDC connections	Screw terminals for 18 to 14 AWG for in/out wiring of zone (+), color coded 18 AWG leads for in/out wiring of zone (–)	
		LED connections	Color coded 18 AWG leads	
		Relay Operation Type	Relay Ratings	
	2-Wire Base with auxiliary	Power-limited	1 A @ 28 VDC	Dual Form "C" contacts, for suppressed loads
	alarm relay output	Nonpower-limited	3 A @ 120 AC	
A4098-9683E Note: Must be connected as the only device on the IDC to ensure relay operation.	Output Type	Wiring Connections		
		IDC connections	Screw terminals for 18 to 14 AWG for in/out wiring of zone (+), color coded 18 AWG leads for in/out wiring of zone (–)	
		Relay connections	Color coded 18 AWG leads	
	4-Wire Base with auxiliary	Relay Operation Type	Relay Ratings	
		Power-limited	3 A @ 28 VDC	Single Form "C" contacts, for suppressed loads
		Nonpower limited	3 A @ 120 AC	
A4098-9682E	alarm relay output NOTE:	Output Type	Wiring Connections	
A4098-9682E	Requires separate 24 VDC power.	IDC connections	Color coded 18 AWG leads for in/out wiring	
		Relay connections	Color coded 18 AWG leads	
		Power connections	Screw terminals for 18 to 14 AWG for in/out wiring of power (+), color coded 18 AWG leads for in/out wiring of power (–)	
Metric wire equ	ivalents: 18 AWG = 0.82 mm2; 14	AWG = 2.08 mm2		

Heat Detector Accessories

SKU	Description	Details	Base Compatibility	
4098-9832	Adapter Plate	Required for surface or semi-flush mounting to 4" (102 mm) square electrical box or for surface mounting to 4" octagonal box	A4098-9682E A4098-9683E	
Adapter Plate	May also be used when retrofitting to replace existing larger diameter bases	A4098-9684E A4098-9788E		
A4098-9830	Remote Red LED Alarm Indicator	Mounted on single gang stainless steel plate, wiring connections are 18 AWG color coded leads	A4098-9684E only	
A2098-9739	End-of-Line Relay	Epoxy encapsulated design, 24 VDC operation, wiring connections are 18 AWG color coded leads	For 4-wire IDCs using A4098-9682E base, one	
A2098-9735	End-of-Line Relay	Mounted on single gang stainless steel plate, 24 VDC operation, wiring connections are 18 AWG color coded leads	per circuit	
Metric wire equ	ivalent: 18 AWG = 0.82 mm	2		



Dimensions and Reference

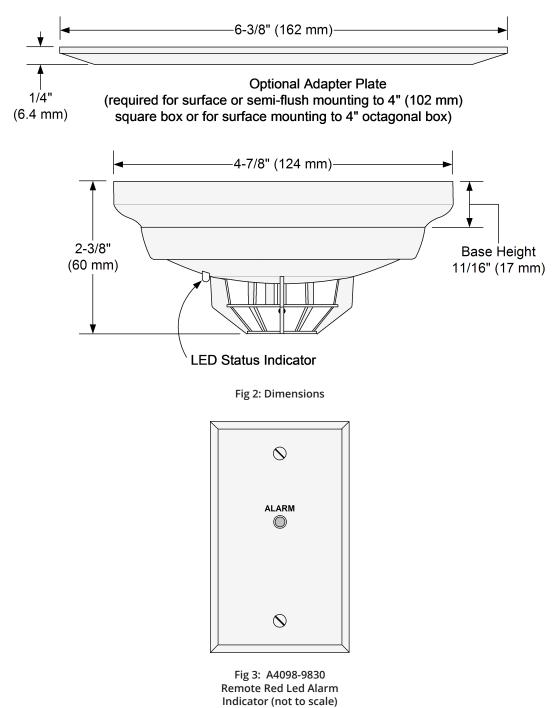



Mounting Information

Base	Electrical Box Requirements
A4098-9788F	4" (102 mm) octagonal or 4" square box, 1-1/2" deep (38 mm)
A4090-9700E	Single gang box, 2" deep (51 mm)
A4098-9682E	
A4098-9683E	4" octagonal or 4" square box, 1-1/2" deep with 1-1/2" deep extension ring (see diagram below)
A4098-9684E	

Applications Reference

The following table provides a reference for the maximum rectangular area covered for detectors rated with the given spacing. For additional information, including consideration of ceiling height, refer to NFPA 72, the National Fire Alarm Code.

Table 2: Maximum Rectangular Area Dimensions for Single Detector Coverage

20 ft Rated Spacing (6.1 m)	50 ft Rated Spacing (15.2 m)	70 ft Rated Spacing (21.3 m)
20 ft x 20 ft (6.1 m x 6.1 m)	50 ft x 50 ft (15.2 m x 15.2 m)	70 ft x 70 ft (21.3 m x 21.3 m)
15 ft x 23.9 ft (4.5 m x 7.2 m)	45 ft x 54.5 ft (13.7 m x 16.6 m)	65 ft x 74.6 ft (19.8 m x 22.7 m)
10 ft x 26.4 ft (3 m x 8 m)	40 ft x 58.2 ft (12.1 m x 17.7 m)	60 ft x 78.7 ft (18.3 m x 24 m)
5 ft x 27.8 ft (1.5 m x 8.4 m)	35 ft x 61.4 ft (10.6 m x 18.7 m)	55 ft x 82.3 ft (16.7 m x 25 m)
1 ft x 28.2 ft (0.3 m x 8.5 m)	30 ft x 64 ft (9.1 m x 19.5 m)	50 ft x 85.4 ft (15.2 m x 26 m)
	25 ft x 66.1 ft (7.6 m x 20.1 m)	45 ft x 88.1 ft (13.7 m x 26.8 m)
	20 ft x 67.8 ft (6.1 m x 20.6 m)	40 ft x 90.5 ft (12.2 m x 27.5 m)
	15 ft x 69 ft (4.5 m x 21 m)	35 ft x 92.6 ft (10.6 m x 28.2 m)
	10 ft x 69.9 ft (3.5 m x 21.3 m)	30 ft x 94.3 ft (9.1 m x 28.7 m)
	5 ft x 70.5 ft (1.5 m x 21.4 m)	25 ft x 95.7 ft (7.6 m x 29.1 m)
	1 ft x 70.6 ft (0.3 m x 21.5 m)	20 ft x 96.9 ft (6.1 m x 29.5 m)
		15 ft x 97.8 ft (4.5 m x 29.8 m)
		10 ft x 98.4 ft (3.05 m x 30 m)
		5 ft x 98.8 ft (1.5 m x 30.1 m)
		1 ft x 99 ft (0.3 m x 30.2 m)



^{© 2017} Johnson Controls. All rights reserved. All specifications and other information shown were current as of document revision and are subject to change without notice. Additional listings may be applicable, contact your local Autocall product supplier for the latest status. Listings and approvals under Tyco Fire & Security GmbH, and the product names listed in this material are marks and/or registered marks. Unauthorized use is strictly prohibited. NFPA 72 and National Fire Alarm Code are registered trademarks of the National Fire Protection Association (NFPA).