




SENSOR BASE WITH 520Hz SOUNDER

AUTOCALL A4098-9772



MOUNTING OPTION "A"

MOUNTING OPTION "B"

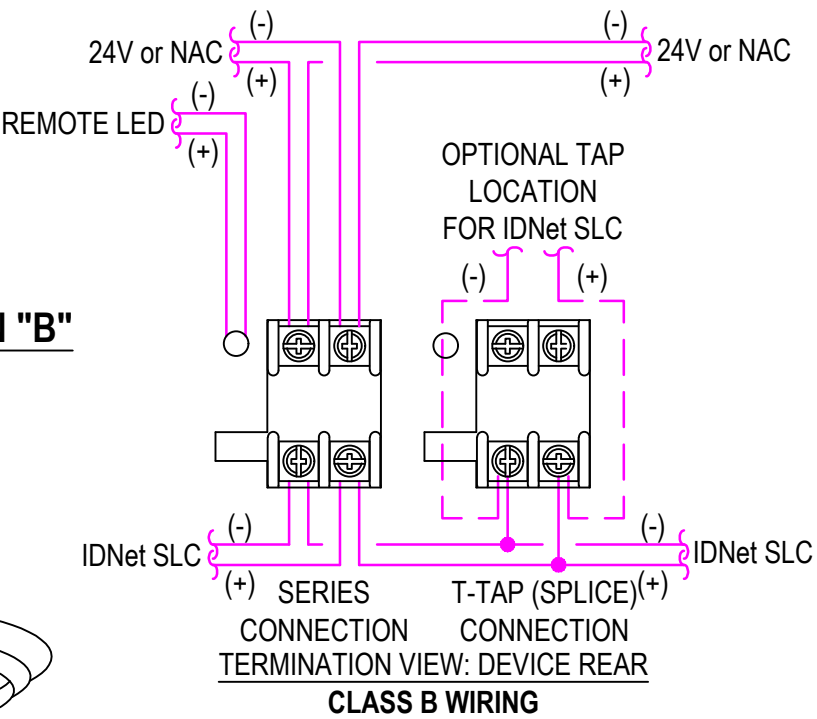

WIRING NOTES

- 1. MAINTAIN CORRECT POLARITY ON TERMINAL CONNECTIONS.
- 2. ALWAYS CUT CONDUCTORS AND SECURE UNDER TERMINALS. NEVER LOOP WIRES UNDER TERMINALS.
- 3. ANY WIRE SPLICES TO BE MADE BY LISTED AND AHJ APPROVED METHODS.

MOUNTING OPTIONS

| OPTION ¹ | DESCRIPTION | NOTE |
|---------------------|---|--|
| A | SINGLE GANG BOX, 2-1/8" (54mm) DEEP - FLUSH MOUNT | BY OTHERS |
| B | 4" (102mm) OCTAGONAL BOX, 1-1/2" (38mm) DEEP, MINIMUM - FLUSH MOUNT | BY OTHERS |
| C | 4" (102mm) SQUARE BOX, 1-1/2" DEEP (MIN) W/ AUTOCALL A4098-9832 ADAPTER KIT | BOX BY OTHERS, A4098-9832 ORDERED SEPARATELY |
| D | 4" (102mm) SQUARE BOX, 1-1/2" DEEP (MIN) W/ SINGLE GANG COVER PLATE 3/4" (19mm) EXTENSION | BY OTHERS |

1. FOR ADDITIONAL MOUNTING OPTIONS, DOWNLOAD DATA SHEET A4098-0054 FROM [HTTP://WWW.AUTOCALL.COM](http://www.autocall.com)



Owner

Project Name

| No. | Description | Date |
|-----|-------------|------------|
| 01 | For Review | 07/14/2021 |
| | | |
| | | |
| | | |

Autocall_A4098 Addressable Bases Detector
A4098-9772

| | | |
|----------------|------------|----|
| Project number | | 01 |
| Date | 07/12/2021 | |
| Drawn by | CV | |
| Checked by | MA | |
| Scale | NTS | |